


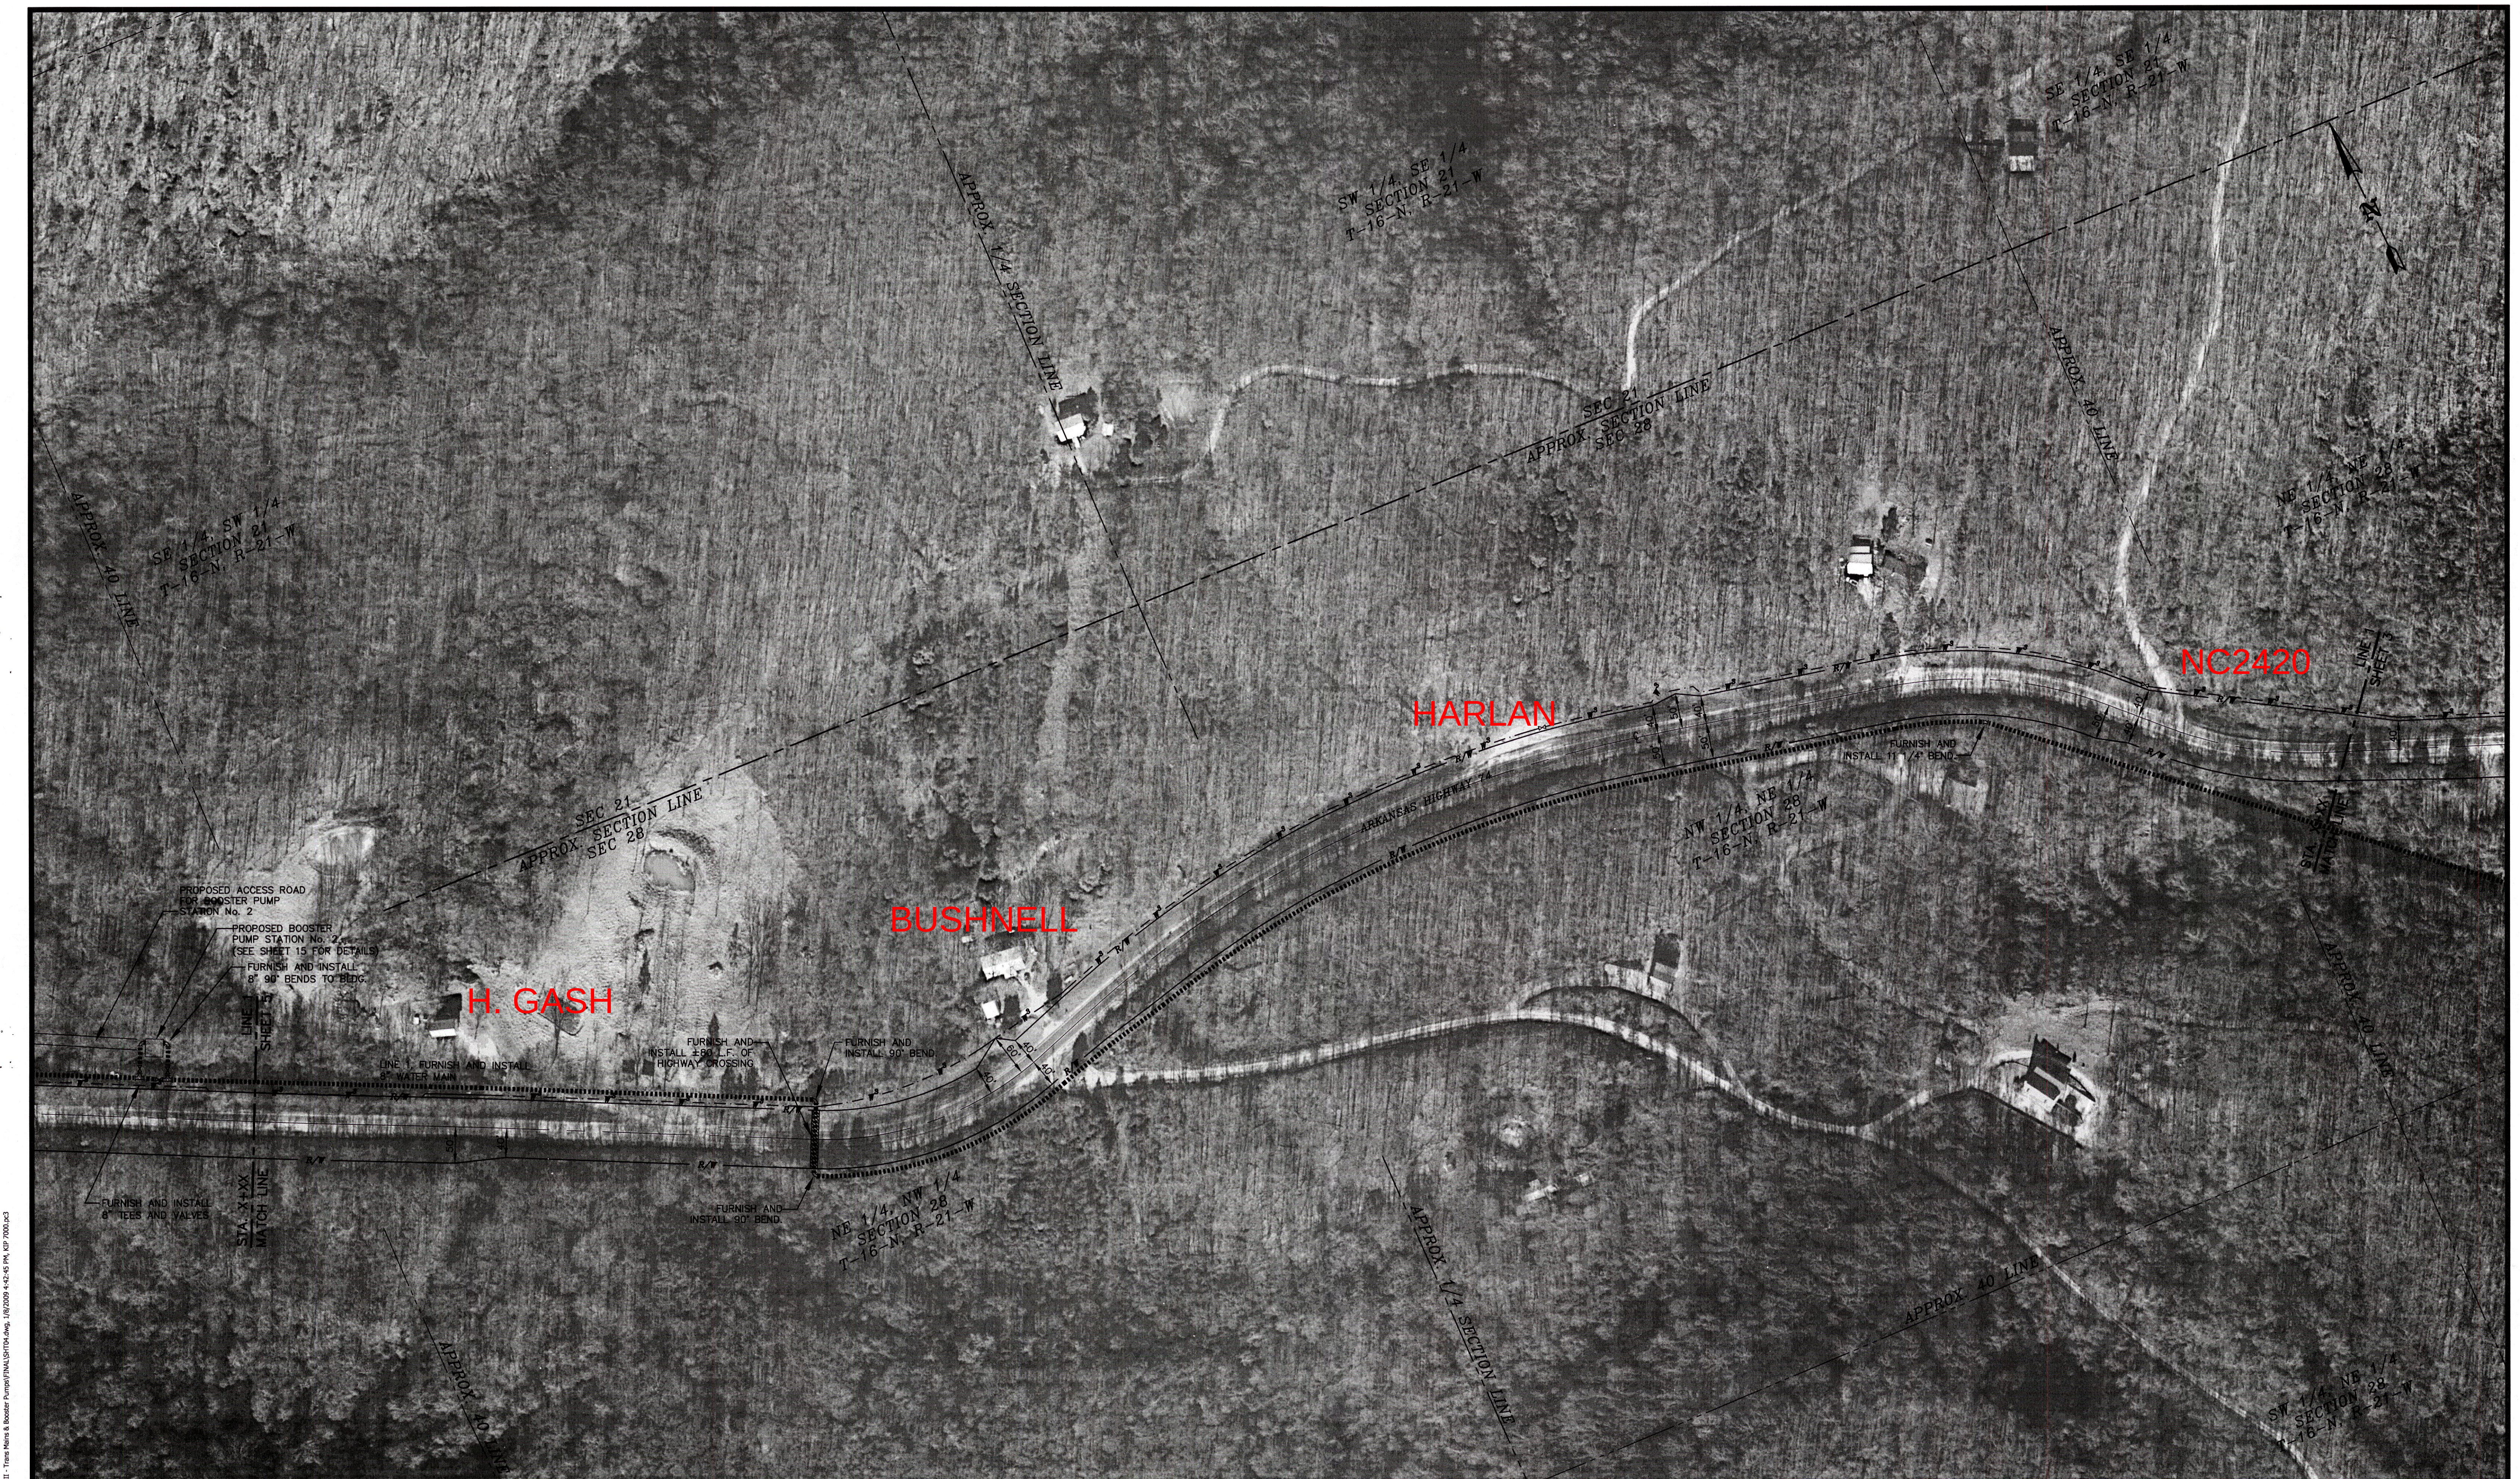

LINE 1 — CLASS 350 D.I. WATER MAIN

GENERAL NOTES:

- All water mains to have a minimum cover of 36 inches over the top of the pipe.
- The owner will provide easements where transmission mains cross private property.
- The contractor shall locate all existing utilities before proceeding with construction. Existing utilities typically are not shown on these plans.


LEGEND

-----	PROPOSED 2" WATER MAIN	○	SINGLE METER SETTING
-----	PROPOSED 3" WATER MAIN	○	DOUBLE METER SETTING
-----	PROPOSED 4" WATER MAIN	○	SINGLE METER SETTING
-----	PROPOSED 6" WATER MAIN	○	1" METER SETTING
-----	PROPOSED 8" WATER MAIN	○	
-----	PROPOSED 12" WATER MAIN	○	
-----	EXISTING WATER MAIN & SIZE	○	

PROPOSED AIR RELEASE VALVE
PROPOSED PRESSURE REDUCING VALVE
PROPOSED GATE VALVE
PROPOSED BLOW-OFF
PROPOSED 3-WAY FIRE HYDRANT
PROPOSED 2-WAY FIRE HYDRANT
PROPOSED LEAK DETECTION METER

REVISION	DATE	DESCRIPTION

SCALE: 1" = ±100'
DATE: JAN. 2009
ENGINEER: XXX
DRAWN BY: XXX
W.O. 08822




ENGINEERING SERVICES, INC.
CONSULTING ENGINEERS AND SURVEYORS
1207 SOUTH OLD MISSOURI RD.
SPRINGDALE, ARKANSAS 72764
© COPYRIGHT, 2009, ENGINEERING SERVICES INC.

CONTRACT SECTION II - WATER TRANSMISSION MAINS
CRITICAL NEEDS PHASE - NEWTON COUNTY IMPROVEMENTS
OZARK MOUNTAIN REGIONAL PUBLIC WATER AUTHORITY
NEWTON COUNTY, ARKANSAS



TIMOTHY J. MAYS
REGISTERED PROFESSIONAL ENGINEER
No. 10441

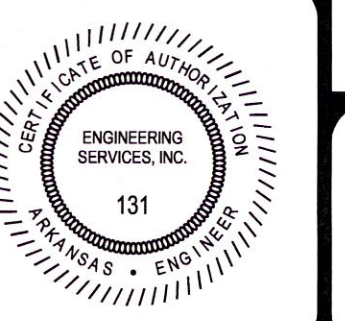

ENGINEERING SERVICES, INC.
No. 131

SHEET No. 4