


Ozark Mountain
Regional Elevated
Storage Tank site
2196' MSL Base

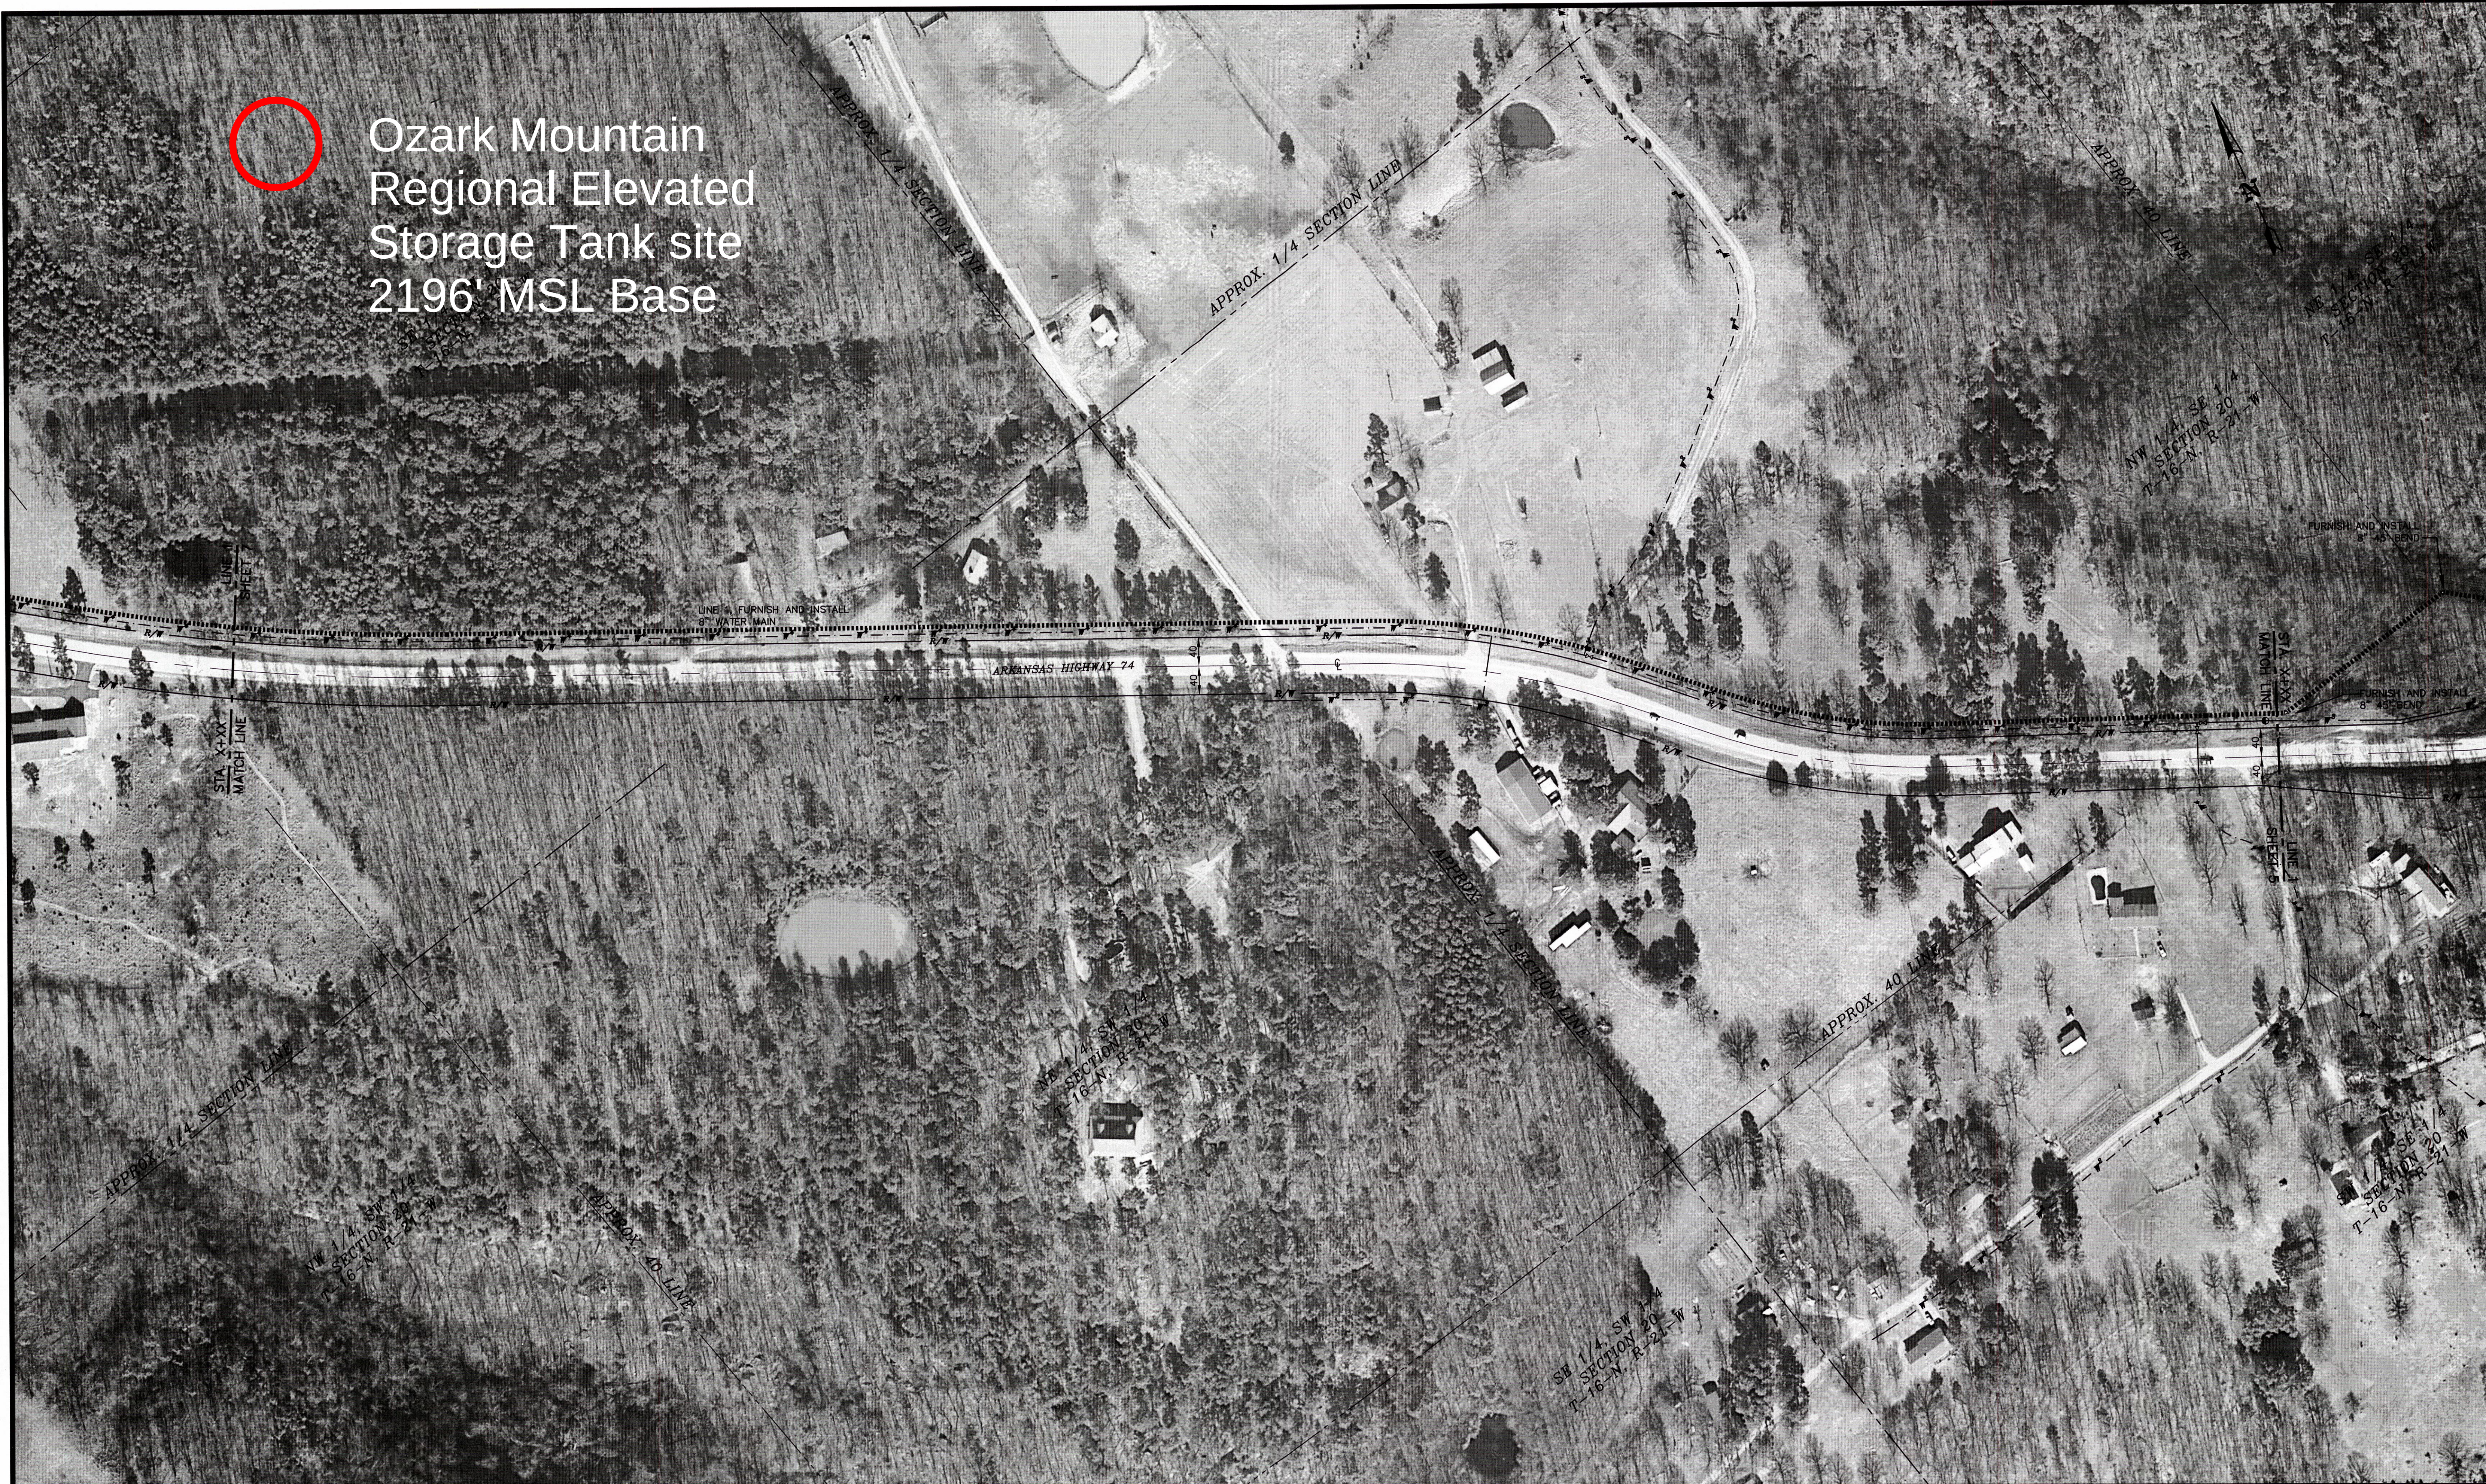

LINE 1 — CLASS 350 D.I. WATER MAIN

- GENERAL NOTES:
- (1) All water mains to have a minimum cover of 36 inches over the top of the pipe.
 - (2) The owner will provide easements where transmission mains cross private property.
 - (3) The contractor shall locate all existing utilities before proceeding with construction. Existing utilities typically are not shown on these plans.


PROPOSED 2" WATER MAIN
PROPOSED 3" WATER MAIN
PROPOSED 4" WATER MAIN
PROPOSED 6" WATER MAIN
PROPOSED 8" WATER MAIN
PROPOSED 12" WATER MAIN
EXISTING WATER MAIN & SIZE

LEGEND	
SERVICE LINE	SINGLE METER SETTING
SERVICE LINE	DOUBLE METER SETTING
SERVICE LINE	SINGLE METER SETTING
SERVICE LINE	1" METER SETTING

PROPOSED AIR RELEASE VALVE
PROPOSED PRESSURE REDUCING VALVE
PROPOSED GATE VALVE
PROPOSED BLOW-OFF
PROPOSED 3-WAY FIRE HYDRANT
PROPOSED 2-WAY FIRE HYDRANT
PROPOSED LEAK DETECTION METER

REVISION	DATE	DESCRIPTION

SCALE: 1" = ±100'
DATE: JAN. 2009
ENGINEER: XXX
DRAWN BY: XXX
W.O. 08822



ENGINEERING SERVICES, INC.
CONSULTING ENGINEERS AND SURVEYORS
1207 SOUTH OLD MISSOURI RD.
SPRINGDALE, ARKANSAS 72764
© COPYRIGHT, 2009, ENGINEERING SERVICES, INC.

CONTRACT SECTION II — WATER TRANSMISSION MAINS
CRITICAL NEEDS PHASE — NEWTON COUNTY IMPROVEMENTS
OZARK MOUNTAIN REGIONAL PUBLIC WATER AUTHORITY
NEWTON COUNTY, ARKANSAS

