


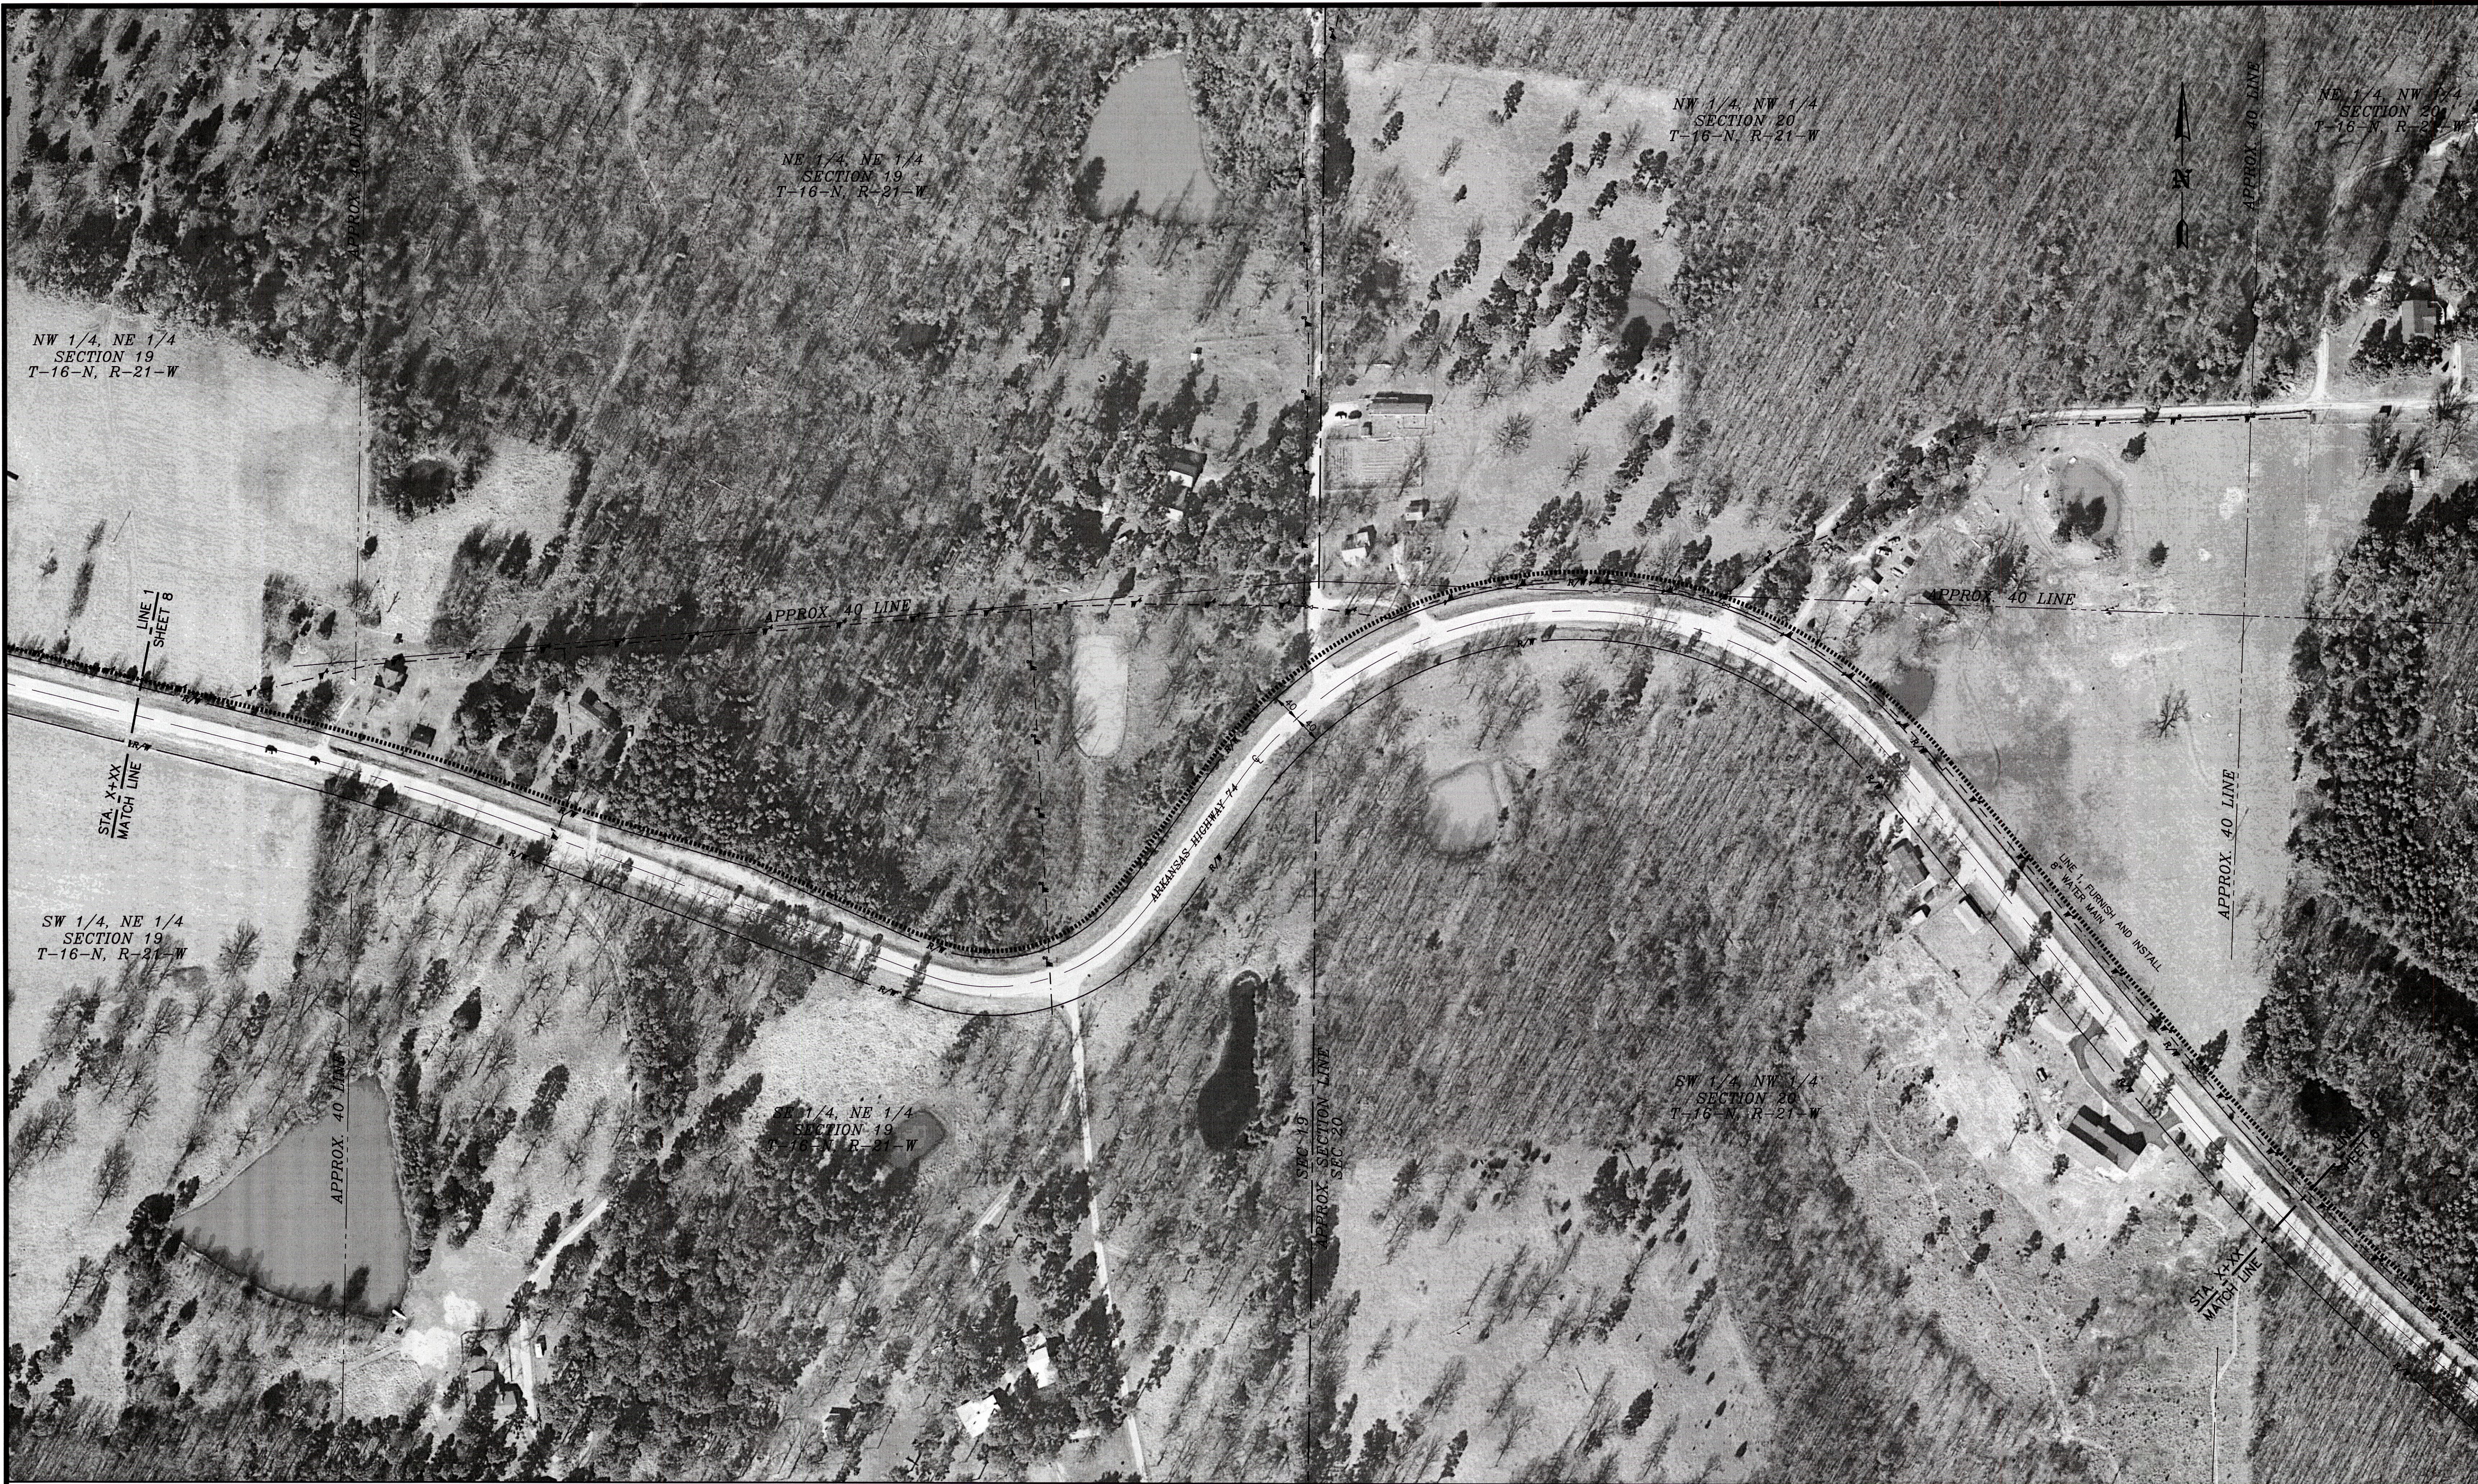

LINE 1 — CLASS 350 D.I. WATER MAIN

GENERAL NOTES:
(1) All water mains to have a minimum cover of 36 inches over the top of the pipe.
(2) The owner will provide easements where transmission mains cross private property.
(3) The contractor shall locate all existing utilities before proceeding with construction. Existing utilities typically are not shown on these plans.

LEGEND

-----	PROPOSED 2" WATER MAIN	○	PROPOSED AIR RELEASE VALVE
-----	PROPOSED 3" WATER MAIN	○	PROPOSED PRESSURE REDUCING VALVE
-----	PROPOSED 4" WATER MAIN	○	PROPOSED GATE VALVE
-----	PROPOSED 6" WATER MAIN	○	PROPOSED BLOW-OFF
-----	PROPOSED 8" WATER MAIN	○	PROPOSED 3-WAY FIRE HYDRANT
-----	PROPOSED 12" WATER MAIN	○	PROPOSED 2-WAY FIRE HYDRANT
-----	EXISTING WATER MAIN & SIZE	○	PROPOSED LEAK DETECTION METER

● SINGLE METER SETTING
● DOUBLE METER SETTING
● SINGLE METER SETTING
● 1" METER SETTING

REVISION	DATE	DESCRIPTION

SCALE: 1" = ±100'
DATE: JAN. 2009
ENGINEER: XXX
DRAWN BY: ---
W.O. 08822

ESI ENGINEERING SERVICES, INC.
CONSULTING ENGINEERS AND SURVEYORS
1207 SOUTH OLD MISSOURI RD.
SPRINGDALE, ARKANSAS 72764
© COPYRIGHT, 2009, ENGINEERING SERVICES, INC.

CONTRACT SECTION II - WATER TRANSMISSION MAINS
CRITICAL NEEDS PHASE - NEWTON COUNTY IMPROVEMENTS
OZARK MOUNTAIN REGIONAL PUBLIC WATER AUTHORITY
NEWTON COUNTY, ARKANSAS

STATE OF ARKANSAS
REGISTERED PROFESSIONAL ENGINEER
No. 10441
TIMOTHY J. MAYS

STATE OF ARKANSAS
REGISTERED PROFESSIONAL ENGINEER
No. 131
TIMOTHY J. MAYS

SHEET No. 7