

Z:\WATER\NEWTON\NEWTON COUNTY\CONT. SEC. II - Trans. Mains & Booster Pumping\FINAL\LS113.dwg, 1/6/2009 1:48:39 PM



LINE 1 — CLASS 350 D.I. WATERMAIN

- GENERAL NOTES:
- (1) All water mains to have a minimum cover of 36 inches over the top of the pipe.
 - (2) The owner will provide easements where transmission mains cross private property.
 - (3) The contractor shall locate all existing utilities before proceeding with construction. Existing utilities typically are not shown on these plans.

-----	PROPOSED 2" WATER MAIN
-----	PROPOSED 3" WATER MAIN
-----	PROPOSED 4" WATER MAIN
-----	PROPOSED 6" WATER MAIN
-----	PROPOSED 8" WATER MAIN
-----	PROPOSED 12" WATER MAIN
-----	EXISTING WATER MAIN & SIZE

LEGEND	
○	SINGLE METER SETTING
●	DOUBLE METER SETTING
○	SINGLE METER SETTING
○	1" METER SETTING

□	PROPOSED AIR RELEASE VALVE
□	PROPOSED PRESSURE REDUCING VALVE
□	PROPOSED GATE VALVE
□	PROPOSED BLOW-OFF
□	PROPOSED 3-WAY FIRE HYDRANT
□	PROPOSED 2-WAY FIRE HYDRANT
□	PROPOSED LEAK DETECTION METER


REVISION	DATE	DESCRIPTION

SCALE: 1" = ±100'
DATE: JAN. 2009
ENGINEER: XXX
DRAWN BY: ---
W.O. 08822



ENGINEERING SERVICES, INC.
CONSULTING ENGINEERS AND SURVEYORS
1207 SOUTH OLD MISSOURI RD.
SPRINGDALE, ARKANSAS 72764
© COPYRIGHT, 2009, ENGINEERING SERVICES INC.

CONTRACT SECTION II - WATER TRANSMISSION MAINS
CRITICAL NEEDS PHASE - NEWTON COUNTY IMPROVEMENTS
OZARK MOUNTAIN REGIONAL PUBLIC WATER AUTHORITY
NEWTON COUNTY, ARKANSAS

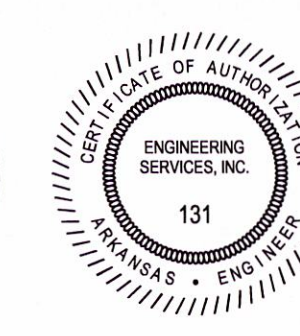

SHEET No.
13