
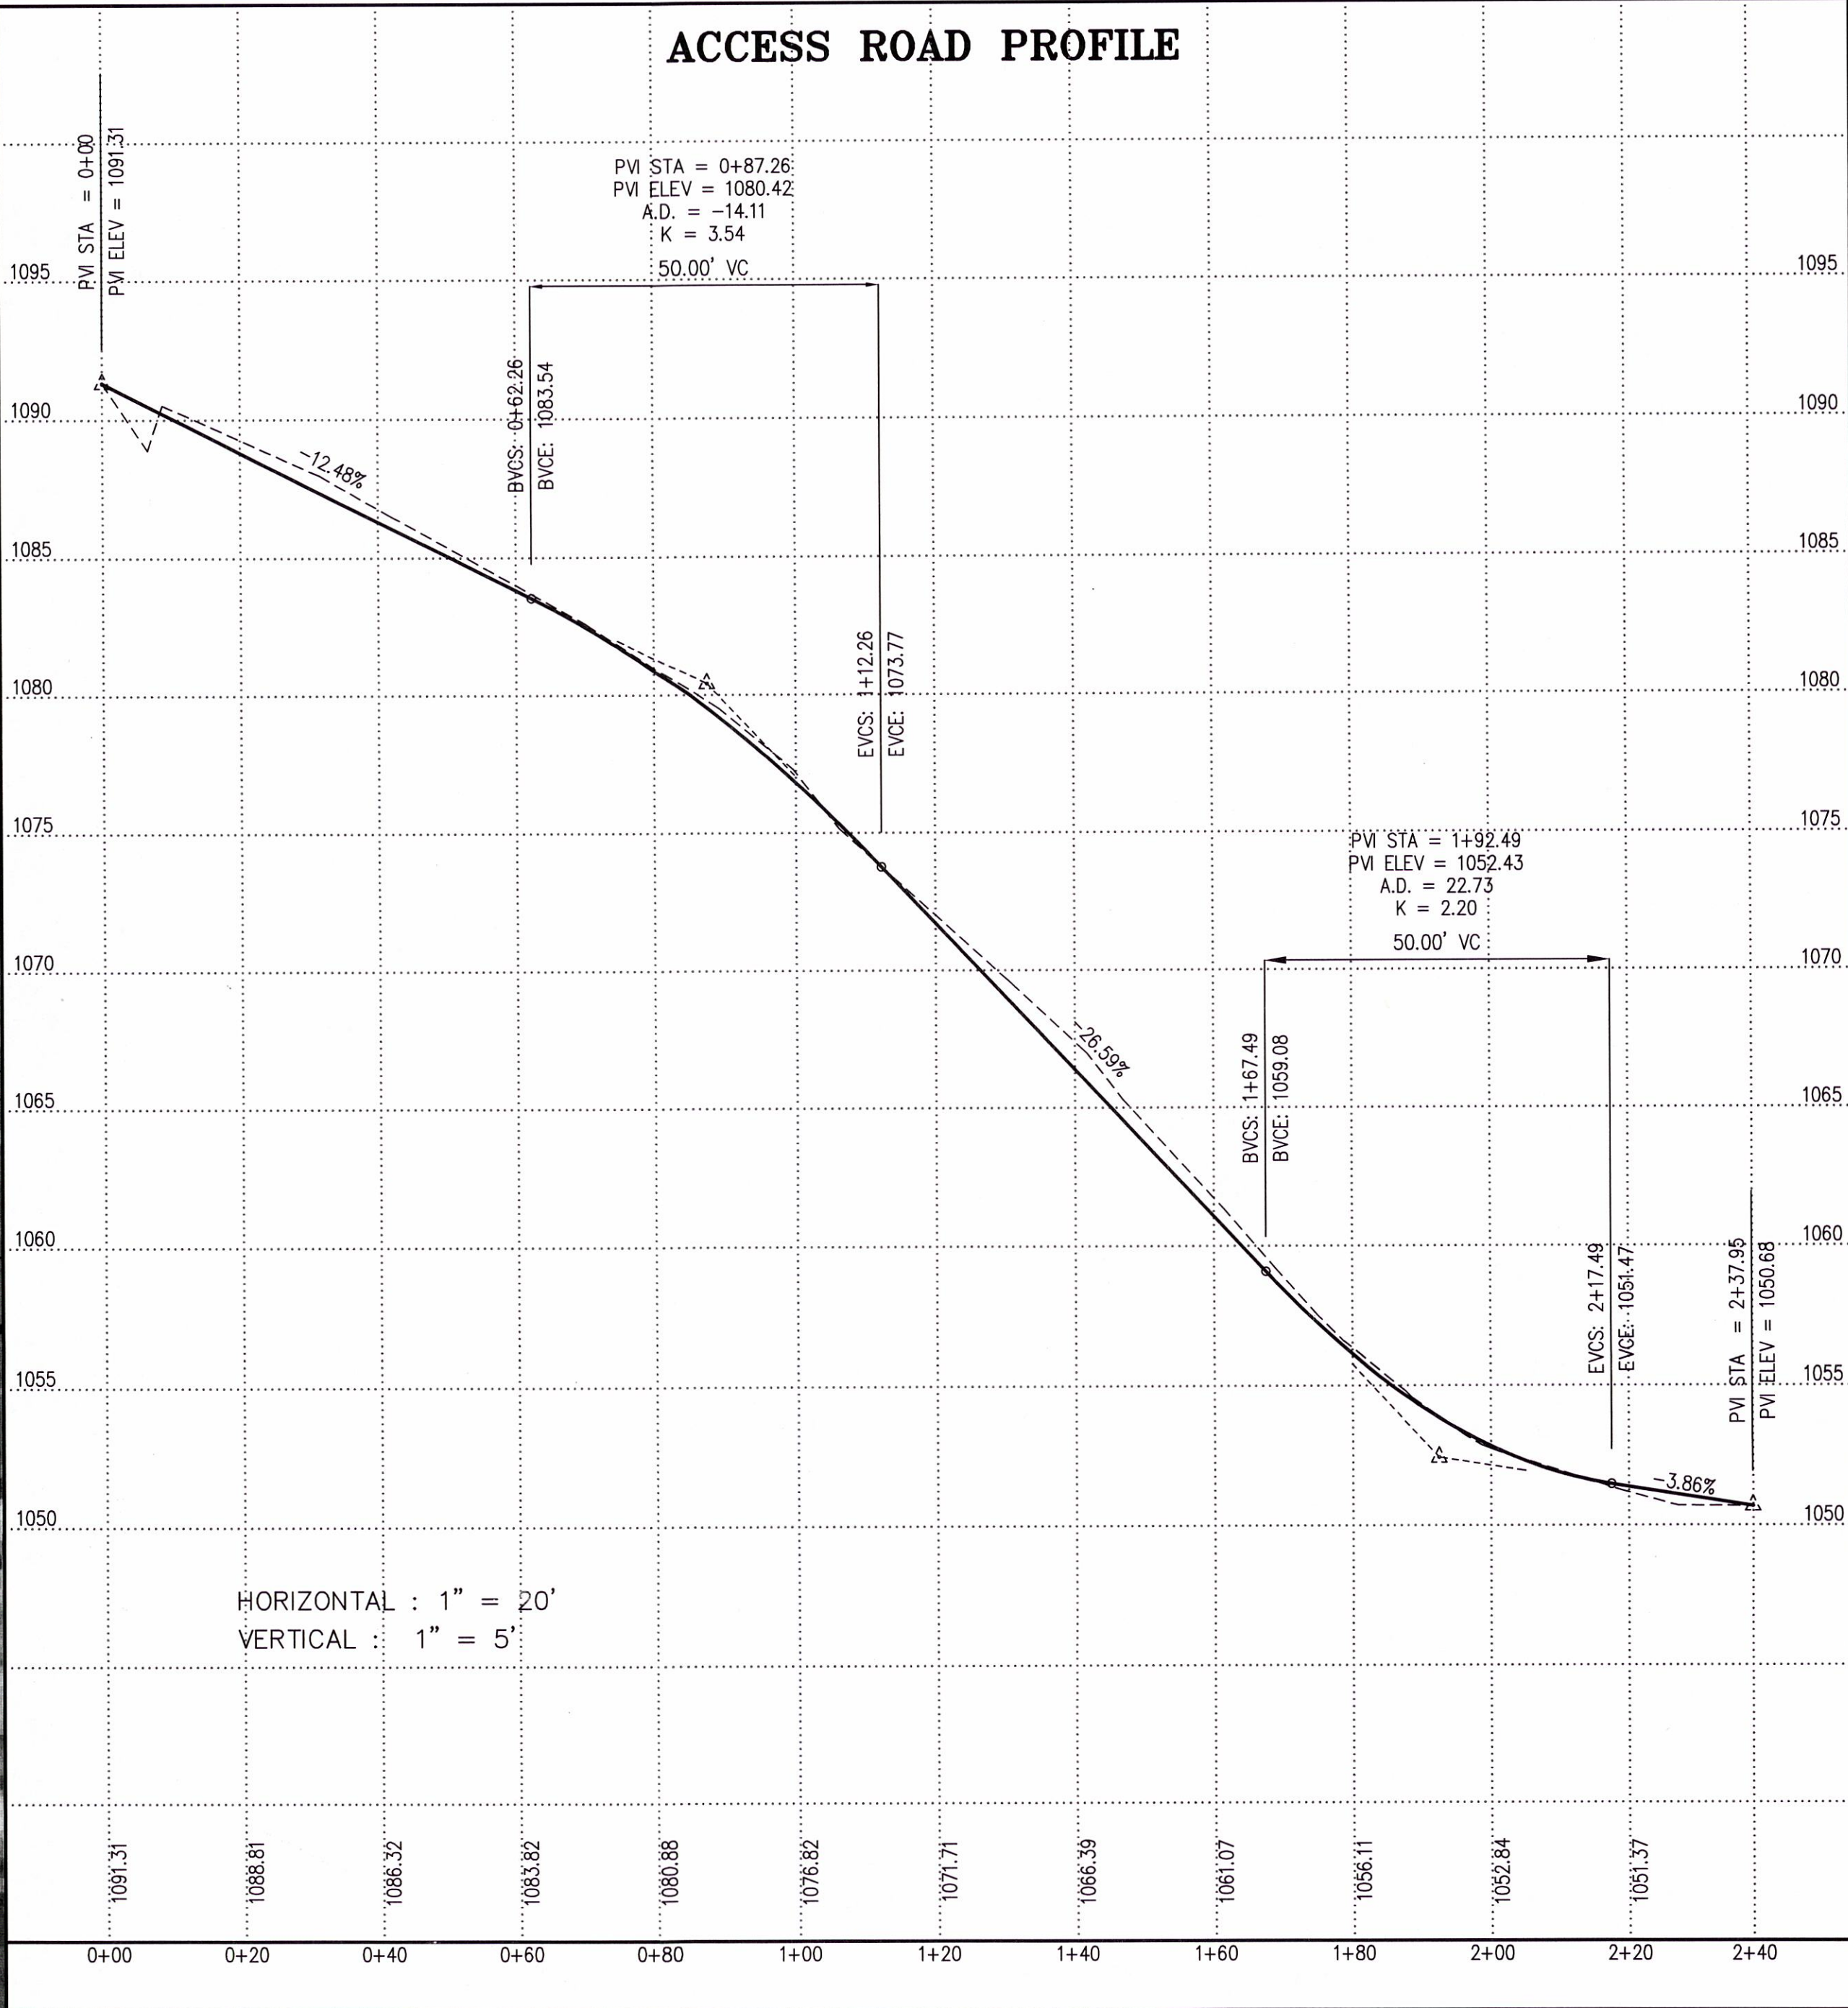


\\WATERWORKS\WATER\0822\NEWTON COUNTY\CONT SEC II - Trans Main & Booster Pump\FINAL\0822 BOOSTER PUMP STATION.dwg, 1/9/2009 8:41:49 AM, XP 7000.dwg

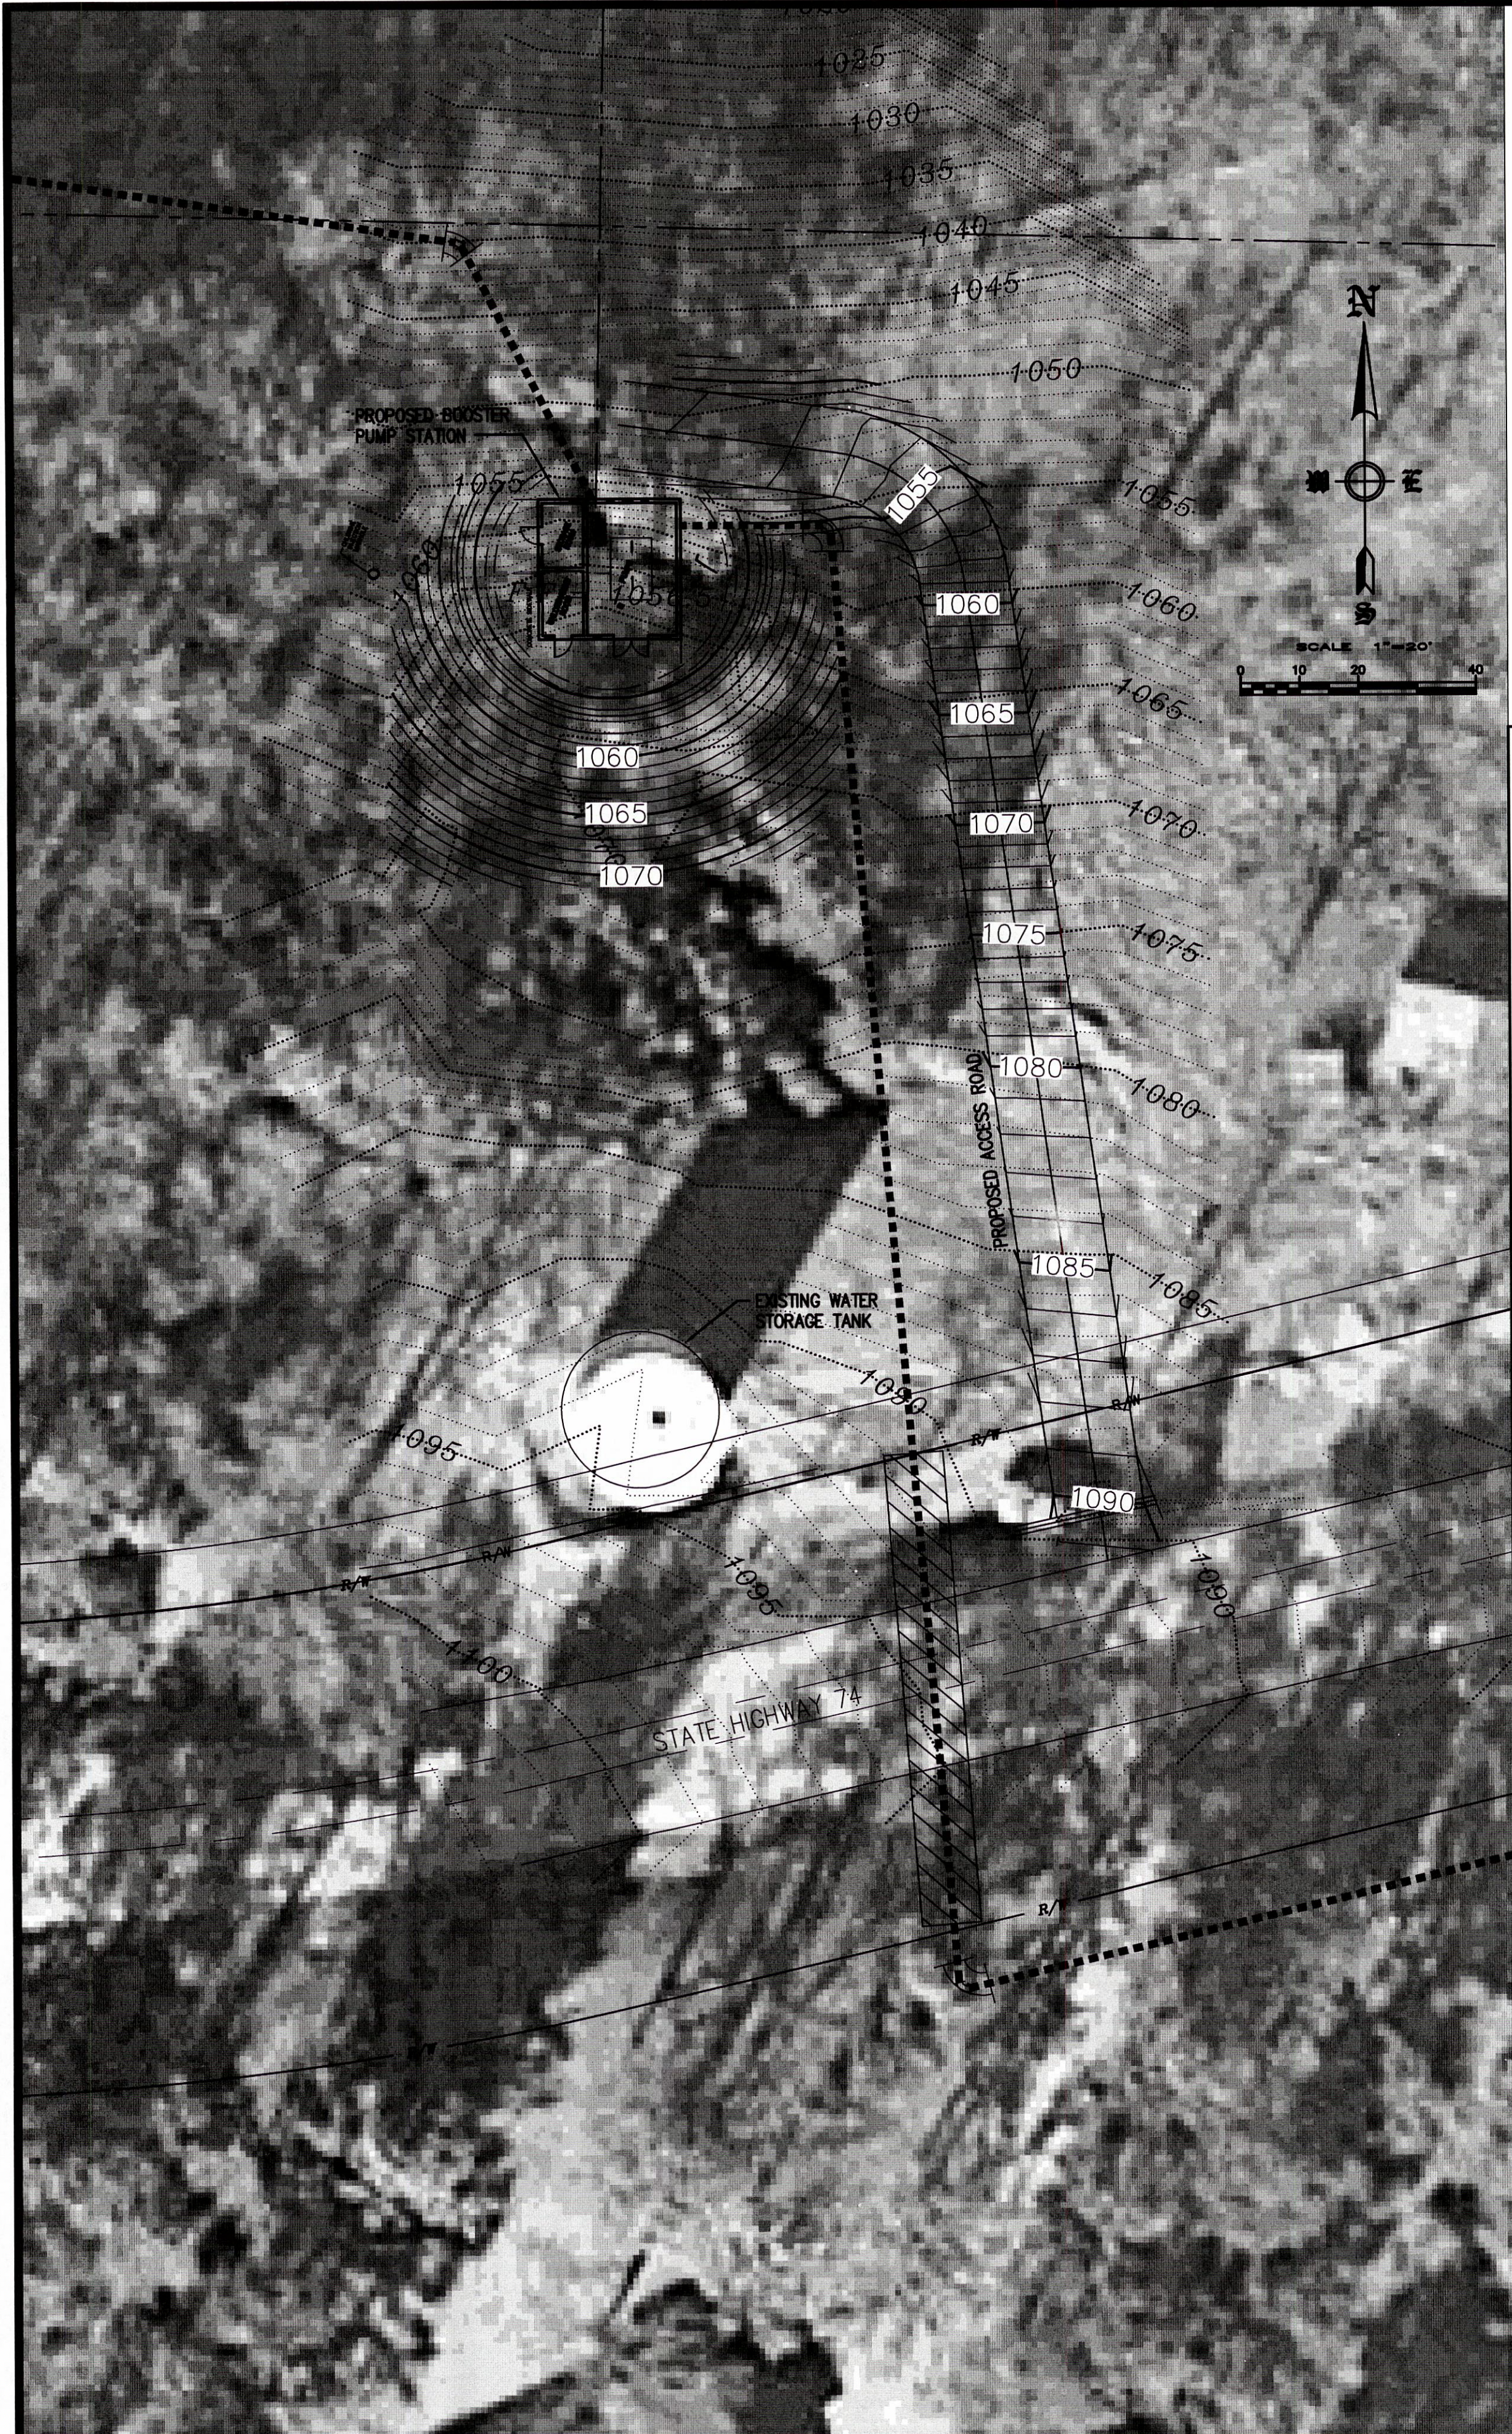


- GENERAL NOTES:
- (1) All water mains to have a minimum cover of 36 inches over the top of the pipe.
 - (2) The owner will provide easements where transmission mains cross private property.
 - (3) The contractor shall locate all existing utilities before proceeding with construction. Existing utilities typically are not shown on these plans.

LEGEND	
	PROPOSED 2" WATER MAIN
	PROPOSED 3" WATER MAIN
	PROPOSED 4" WATER MAIN
	PROPOSED 6" WATER MAIN
	PROPOSED 8" WATER MAIN
	PROPOSED 12" WATER MAIN
	EXISTING WATER MAIN & SIZE
	SINGLE METER SETTING
	DOUBLE METER SETTING
	SINGLE METER SETTING
	1" METER SETTING

	PROPOSED AIR RELEASE VALVE
	PROPOSED PRESSURE REDUCING VALVE
	PROPOSED GATE VALVE
	PROPOSED BLOW-OFF
	PROPOSED 3-WAY FIRE HYDRANT
	PROPOSED 2-WAY FIRE HYDRANT
	PROPOSED LEAK DETECTION METER


REVISION	DATE	DESCRIPTION

SCALE: 1" = 20'
DATE: JAN. 2009
ENGINEER: XXX
DRAWN BY: ---
W.O. 08822



ENGINEERING SERVICES, INC.
CONSULTING ENGINEERS AND SURVEYORS
1207 SOUTH OLD MISSOURI RD.
SPRINGDALE, ARKANSAS 72764
© COPYRIGHT, 2009, ENGINEERING SERVICES INC.

CONTRACT SECTION II - BOOSTER PUMP STATION
CRITICAL NEEDS PHASE - NEWTON COUNTY IMPROVEMENTS
OZARK MOUNTAIN REGIONAL PUBLIC WATER AUTHORITY
NEWTON COUNTY, ARKANSAS

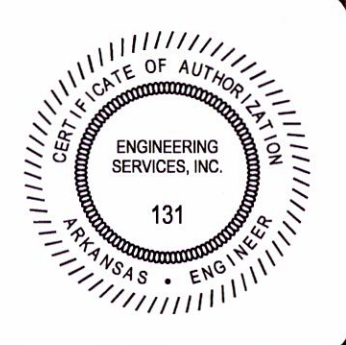

SHEET No. 14